

Report # K-352124-05-A-R00

Samples Received:
Dec-11-18

Samples Tested:
Dec-13-18

Test Report

Kinectrics Inc., 800 Kipling Avenue, Unit 2
Toronto, Ontario, Canada
Tel: 416-207-6000, www.kinectrics.com



Tested for

Polison Corporation
No. 282 Heping Second Road
Kaohsiung 80651
Taiwan (R.O.C.)

Contact information for item tested:

Mr. David Cheng
No. 282 Heping Second Road
Kaohsiung 80651
Taiwan (R.O.C.)

Test item description

3 Layer System,
(L1) 4.9 oz/yd² Plain Weave,
40% Para-Aramid, 30% Novaloid, 30% O-Pan, Dark Olive Green, Weight as Tested: 5.2oz/yd²;
(L2) 2.7 oz/yd² Non-Woven Spunlace,
50% Melamine, 25% Meta-Aramid, 25% Para-Aramid, Yellow;
(L3) 3.2 oz/yd² Plain Weave,

Reference Standard

IEC 61482-1-1:2019 Method A, ASTM F1959/F1959M-14e1
Complying with both IEC and ASTM Standard Test Method for Determining the Arc Rating of Materials for Clothing

Test Parameters:

Test current: 8 kA
Arc Gap: 30 cm
Distance to Fabric: 30 cm
Number of samples analysed: 24
Incident Energy Range: 36 to 58 cal/cm²

Arc Rating, ATPV = 46 Cal/cm²

Material Break-Open, Ebt = 51 Cal/cm²

Heat Attenuation Factor, HAF = 95%

Material break-open threshold energy (Ebt) above ATPV determined as requested by client.

No variations to standard method noted.

Samples tested as received, samples not laundered.

Test Summary

The Arc Rating of this material is intended for use as part of a flame resistant garment or system for workers exposed to electric arcs. The test result is applicable only to the test item as described; other fiber blends, weaves, finishing or dye may have different protection level. The test articles are tested as received; no test is done to validate the fiber content or composition. The Arc Rating was calculated based on the data obtained and analysed in accordance with the latest version of the applicable standards. The individual test sheets, graphs, photographs of the samples and video of every test are provided in digital format to the Client for review.


The arc testing performed to the above mentioned Standard is accredited by the Standards Council of Canada (SCC) to conform to the requirements of CAN-P-4E (ISO/IEC 17025:2005). Accreditation by the Standards Council of Canada (SCC) is a mark of competence and reliability recognized throughout the world.

Kinectrics Inc takes reasonable steps to ensure that all work performed shall meet the industry standards as set out in Kinectrics Inc.'s Quality Manual, and that all reports shall be reasonably free of errors, inaccuracies or omissions. KINECTRICS INC. DOES NOT MAKE ANY WARRANTY OR REPRESENTATION WHATSOEVER, EXPRESS OR IMPLIED, WITH RESPECT TO THE MERCHANTABILITY OR FITNESS FOR ANY PARTICULAR PURPOSE OF ANY INFORMATION CONTAINED IN THIS REPORT OR THE RESPECTIVE WORKS OR SERVICES SUPPLIED OR PERFORMED BY KINECTRICS INC. Kinectrics Inc. does not accept any liability for any damages, either directly, consequentially or otherwise resulting from the use of this report.

Note: The test performed does not apply to electrical contact or electrical shock hazard.


©Kinectrics. Partial reproduction of this report is strictly prohibited without the express written consent of Kinectrics Inc.

Prepared by:


Yosbani Guerra
2019.11.27
09:17:52 -05'00'

Yosbani Guerra
HCL Technologist
Kinectrics Inc.

Approved by:


Andrew Haines
2019.11.27
09:43:39 -05'00'

Andrew Haines
HCL Supervising Technologist
Kinectrics Inc.

Note: For verification about results in this report, please forward copy of the report or inquiry to hcl@kinectrics.com

Date:
Dec-13-18

Determination of ATPV by performing logistic regression on the panel burn response as indicated in Summary Table




Report #
K-352124-05-A-R00

Test Performed in accordance with: IEC 61482-1-1:2019 Method A,
ASTM F1959/F1959M-14e1

Fabric Description:

3 Layer System,
(L1) 4.9 oz/yd² Plain Weave,
40% Para-Aramid, 30% Novaloid, 30% O-Pan, Dark Olive Green, Weight as Tested: 5.2oz/yd²;
(L2) 2.7 oz/yd² Non-Woven Spunlace,
50% Melamine, 25% Meta-Aramid, 25% Para-Aramid, Yellow;
(L3) 3.2 oz/yd² Plain Weave,

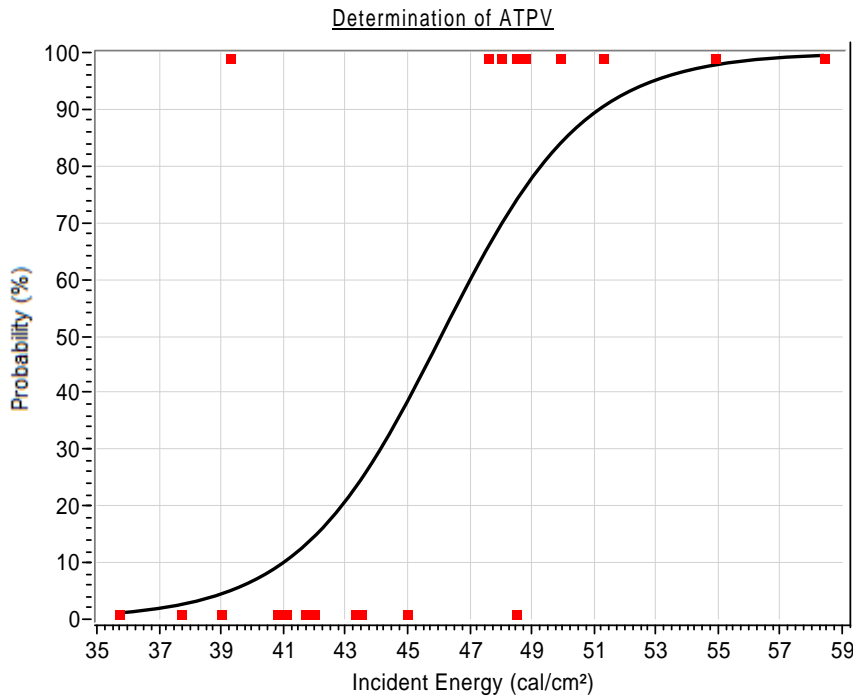


ATPV = 46 cal/cm²

Probability	Ei
5%	39.3
10%	41.0
20%	42.9
30%	44.1
40%	45.1
50%	46.1
60%	47.0
70%	48.1
80%	49.3
90%	51.2


(Note: ATPV is reported to nearest integer for ratings above 10 cal/cm²)

Total points analyzed = 24
Points above Stoll = 12
Points above mix zone = 9
Points below mix zone = 3
Pts within 20% = 22
Pts in mix zone = 10

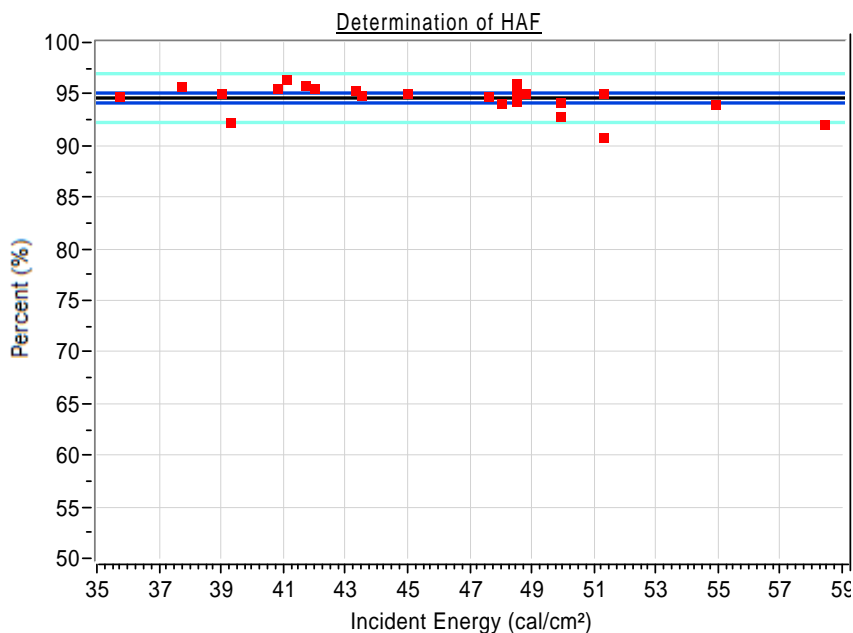

HAF = 95 %

Confidence Intervals
95% CI = 94.5 , 95.5



Date:
Dec-13-18

Report #
K-352124-05-A-R00

Determination of Ebt by performing logistic regression on the panel
break-open response as indicated in Summary Table


Test Performed in accordance with: IEC 61482-1-1:2019 Method A,
ASTM F1959/F1959M-14e1



Fabric Description:

3 Layer System,
(L1) 4.9 oz/yd² Plain Weave,
40% Para-Aramid, 30% Novaloid, 30% O-Pan, Dark Olive Green, Weight as Tested: 5.2oz/yd²;
(L2) 2.7 oz/yd² Non-Woven Spunlace,
50% Melamine, 25% Meta-Aramid, 25% Para-Aramid, Yellow;
(L3) 3 2 oz/yd² Plain Weave

Determination of Ebt, 50% of Probability of Breakopen

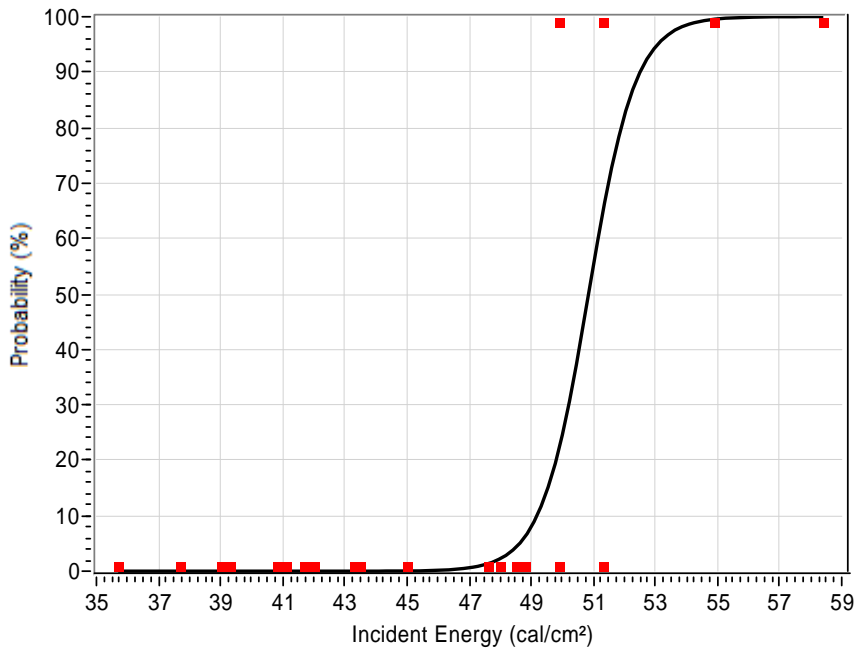


Ebt = 51 cal/cm²

Probability	Ei
5%	48.6
10%	49.2
20%	49.8
30%	50.2
40%	50.5
50%	50.8
60%	51.2
70%	51.5
80%	51.9
90%	52.5

(Note: Ebt is reported to nearest integer for ratings above 10 cal/cm²)


Total points analyzed = 24
Points Break-Open = 4
Points above mix zone = 3
Points below mix zone = 18
Pts within 20% = 20
Pts in mix zone = 2

Determination of HAF

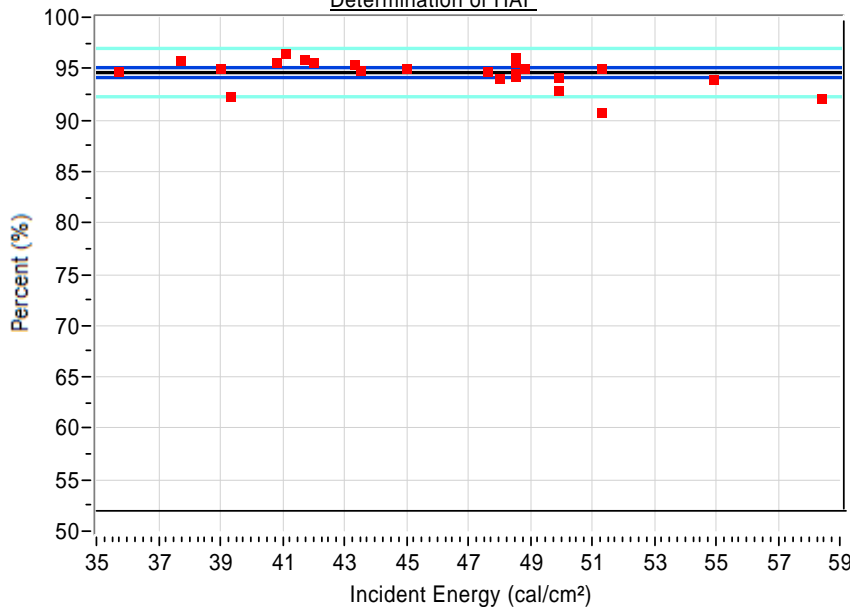

HAF = 95 %

Confidence Intervals
95% CI = 94.5 , 95.5



Date:
Dec-13-18

Summary of Measured Energy and Observations



Report #
K-352124-05-A-R00

Test Performed in accordance with : IEC 61482-1-1:2019 Method A, ASTM F1959/F1959M-14e1

Fabric Description: 3 Layer System,
(L1) 4.9 oz/yd² Plain Weave,
40% Para-Aramid, 30% Novaloid, 30% O-Pan, Dark Olive Green, Weight as Tested: 5.2oz/yd²;
(L2) 2.7 oz/yd² Non-Woven Spunlace,
50% Melamine, 25% Meta-Aramid, 25% Para-Aramid, Yellow;
(L3) 3.2 oz/yd² Plain Weave,

	Test #	Panel	Test Current A	Cycles of 60Hz	Ei Cal/cm ²	SCD Cal/cm ²	HAF %	>Stoll Y/N	Break Open Y/N	Ablation Y/N	After Flame sec.	Omit Y/N	Comment
1	K-352124-7420	A	8121	52.2	48.0	0.4	94.1	Yes	N	Y	2.5	No	
2	K-352124-7420	B	8121	52.2	39.0	-0.6	95.1	No	N	N	2.5	No	
3	K-352124-7420	C	8121	52.2	48.5	0.2	94.6	Yes	N	Y	2.5	No	
4	K-352124-7421	A	8137	55.2	48.5	0.4	94.3	Yes	N	Y	2	No	
5	K-352124-7421	B	8137	55.2	43.5	-0.2	94.9	No	N	N	3	No	
6	K-352124-7421	C	8137	55.2	47.6	0.1	94.8	Yes	N	Y	3.5	No	
7	K-352124-7422	A	8103	60.3	58.4	2.5	92.1	Yes	Y	Y	4.5	No	
8	K-352124-7422	B	8103	60.3	48.5	-0.2	95.6	No	N	Y	2	No	
9	K-352124-7422	C	8103	60.3	48.5	-0.4	96.1	No	N	Y	1.5	No	
10	K-352124-7423	A	8123	48.2	41.7	-0.6	95.9	No	N	N	2	No	
11	K-352124-7423	B	8123	48.2	42.0	-0.5	95.6	No	N	N	2	No	
12	K-352124-7423	C	8123	48.2	41.1	-0.7	96.5	No	N	N	1.5	No	
13	K-352124-7424	A	8123	56.2	49.9	1.2	92.9	Yes	Y	Y	2.5	No	
14	K-352124-7424	B	8123	56.2	49.9	0.6	94.2	Yes	N	Y	2	No	
15	K-352124-7424	C	8123	56.2	45.0	-0.2	95.1	No	N	Y	3	No	
16	K-352124-7425	A	8127	65.3	54.9	0.8	94.0	Yes	Y	Y	1.5	No	
17	K-352124-7425	B	8127	65.3	51.3	2.7	90.8	Yes	Y	Y	1.5	No	
18	K-352124-7425	C	8127	65.3	51.3	0.1	95.1	Yes	N	Y	3	No	
19	K-352124-7426	A	8115	54.2	48.8	0.0	95.1	Yes	N	Y	1.5	No	
20	K-352124-7426	B	8115	54.2	43.3	-0.3	95.4	No	N	Y	2.5	No	
21	K-352124-7426	C	8115	54.2	39.3	0.6	92.3	Yes	N	Y	3.5	No	
22	K-352124-7427	A	8129	45.2	40.8	-0.5	95.6	No	N	N	1.5	No	
23	K-352124-7427	B	8129	45.2	37.7	-0.5	95.8	No	N	N	2	No	
24	K-352124-7427	C	8129	45.2	35.7	-0.5	94.8	No	N	N	5	No	
25													
26													
27													
28													
29													
30													
31													
32													
33													
34													
35													
36													
37													
--													

24 samples exhibited afterflame during testing for an average duration of 2.5 seconds.